SUBMITTAL RECORD
JOB
LOCATION
SUBMITTED TO
SUBMITTAL PREPARED BY
APPROVED BY
D. ATTE




Submittal Form UL10B Static 1-1/2 Hour Fire-Limit UL Fire Damper Vertical or Horizontal

UNDERWRITERS' LABORATORIES INC.							
CLASSIFIED							
FIRE RESISTANCE RATING 1-1/2 HOUR							

See U.L. Classified Building Materials Index









No



Approved by the Board of Standards and Appeals for use in New York City Cal. 291-80-SA

Accepted for use City of New York Department of Buildings MEA#: 302-00-M



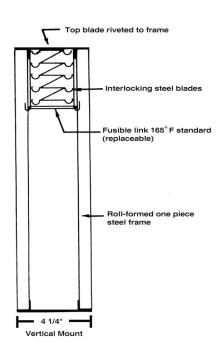

- Standard construction materials: Galvanized Steel
- Specification for all material per Underwriters' Laboratories Standard for Safety UL555.
- Underwriters' Laboratories: Labeled for use in sizes no larger than shown in U.L. Building Material List.
- Meets National Fire Protection Assoc. NFPA 90A

Damper Mounting	Minimum Duct Size (in.)		Single Section Damper Size Maximum (in.)		Multiple Section Damper Size Maximum (in.)	
Position	Width	Height	Width	Height	Width	Height
Vertical	4	3	60	60	120	120
Horizontal	4	3	34	60	102	60
	4	3	60	60	-	-

SUGGESTED SPECIFICATIONS

Fire Dampers shall be Duro Dyne UL10B Static type dampers. Installation shall be as described in the Duro Dyne Fire Damper instructions. Sizes and locations shall be as indicated on the mechanical drawings.

